




GROUND FLOOR LIGHTING | Automation Outlet Electrical Layouts

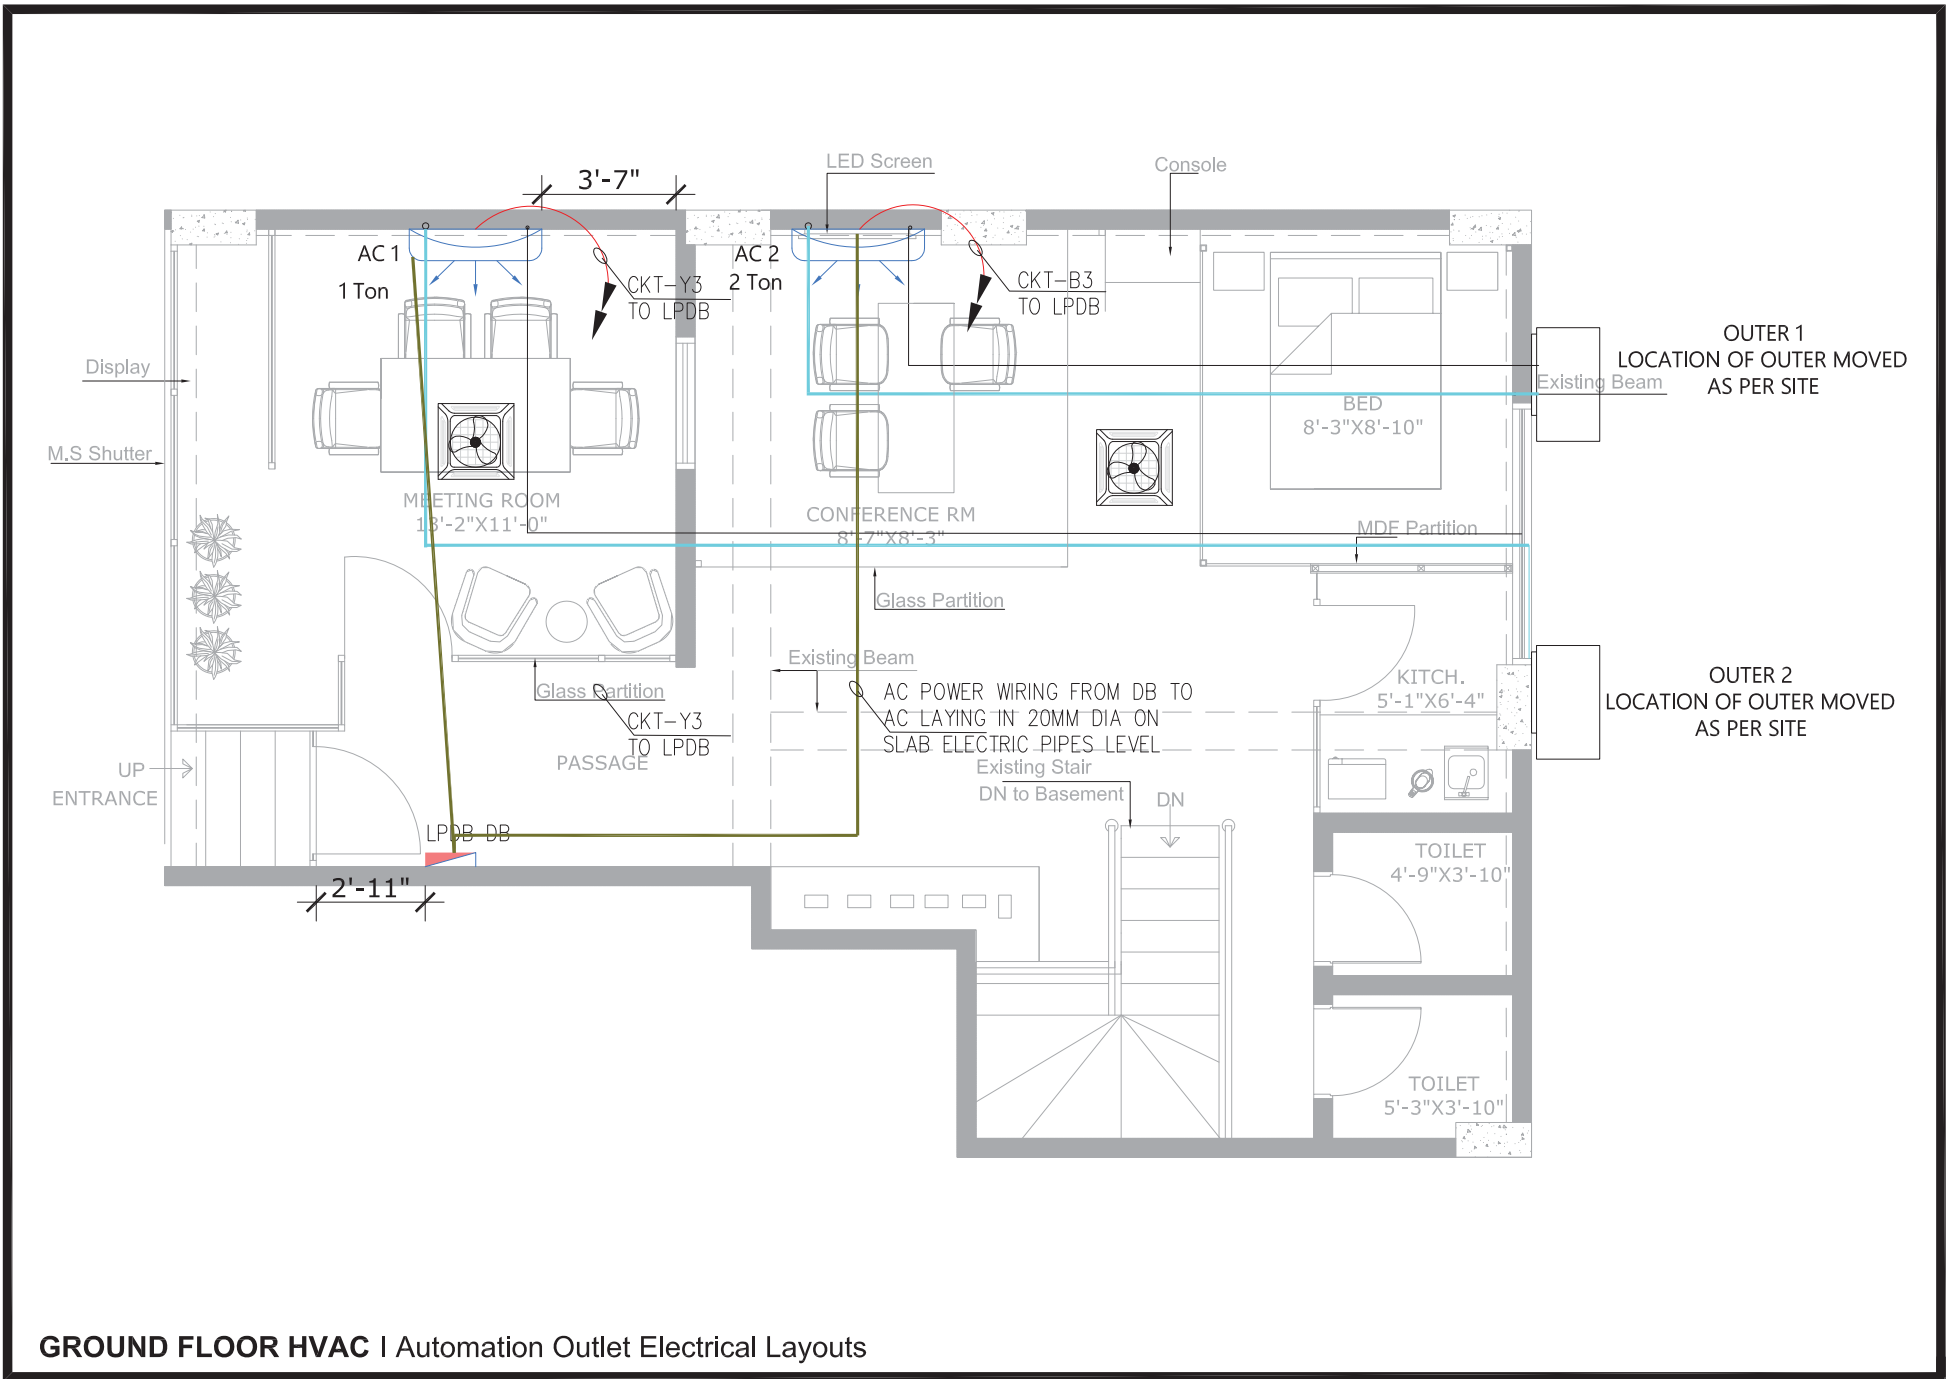

GROUND FLOOR HVAC | Automation Outlet Electrical Layouts

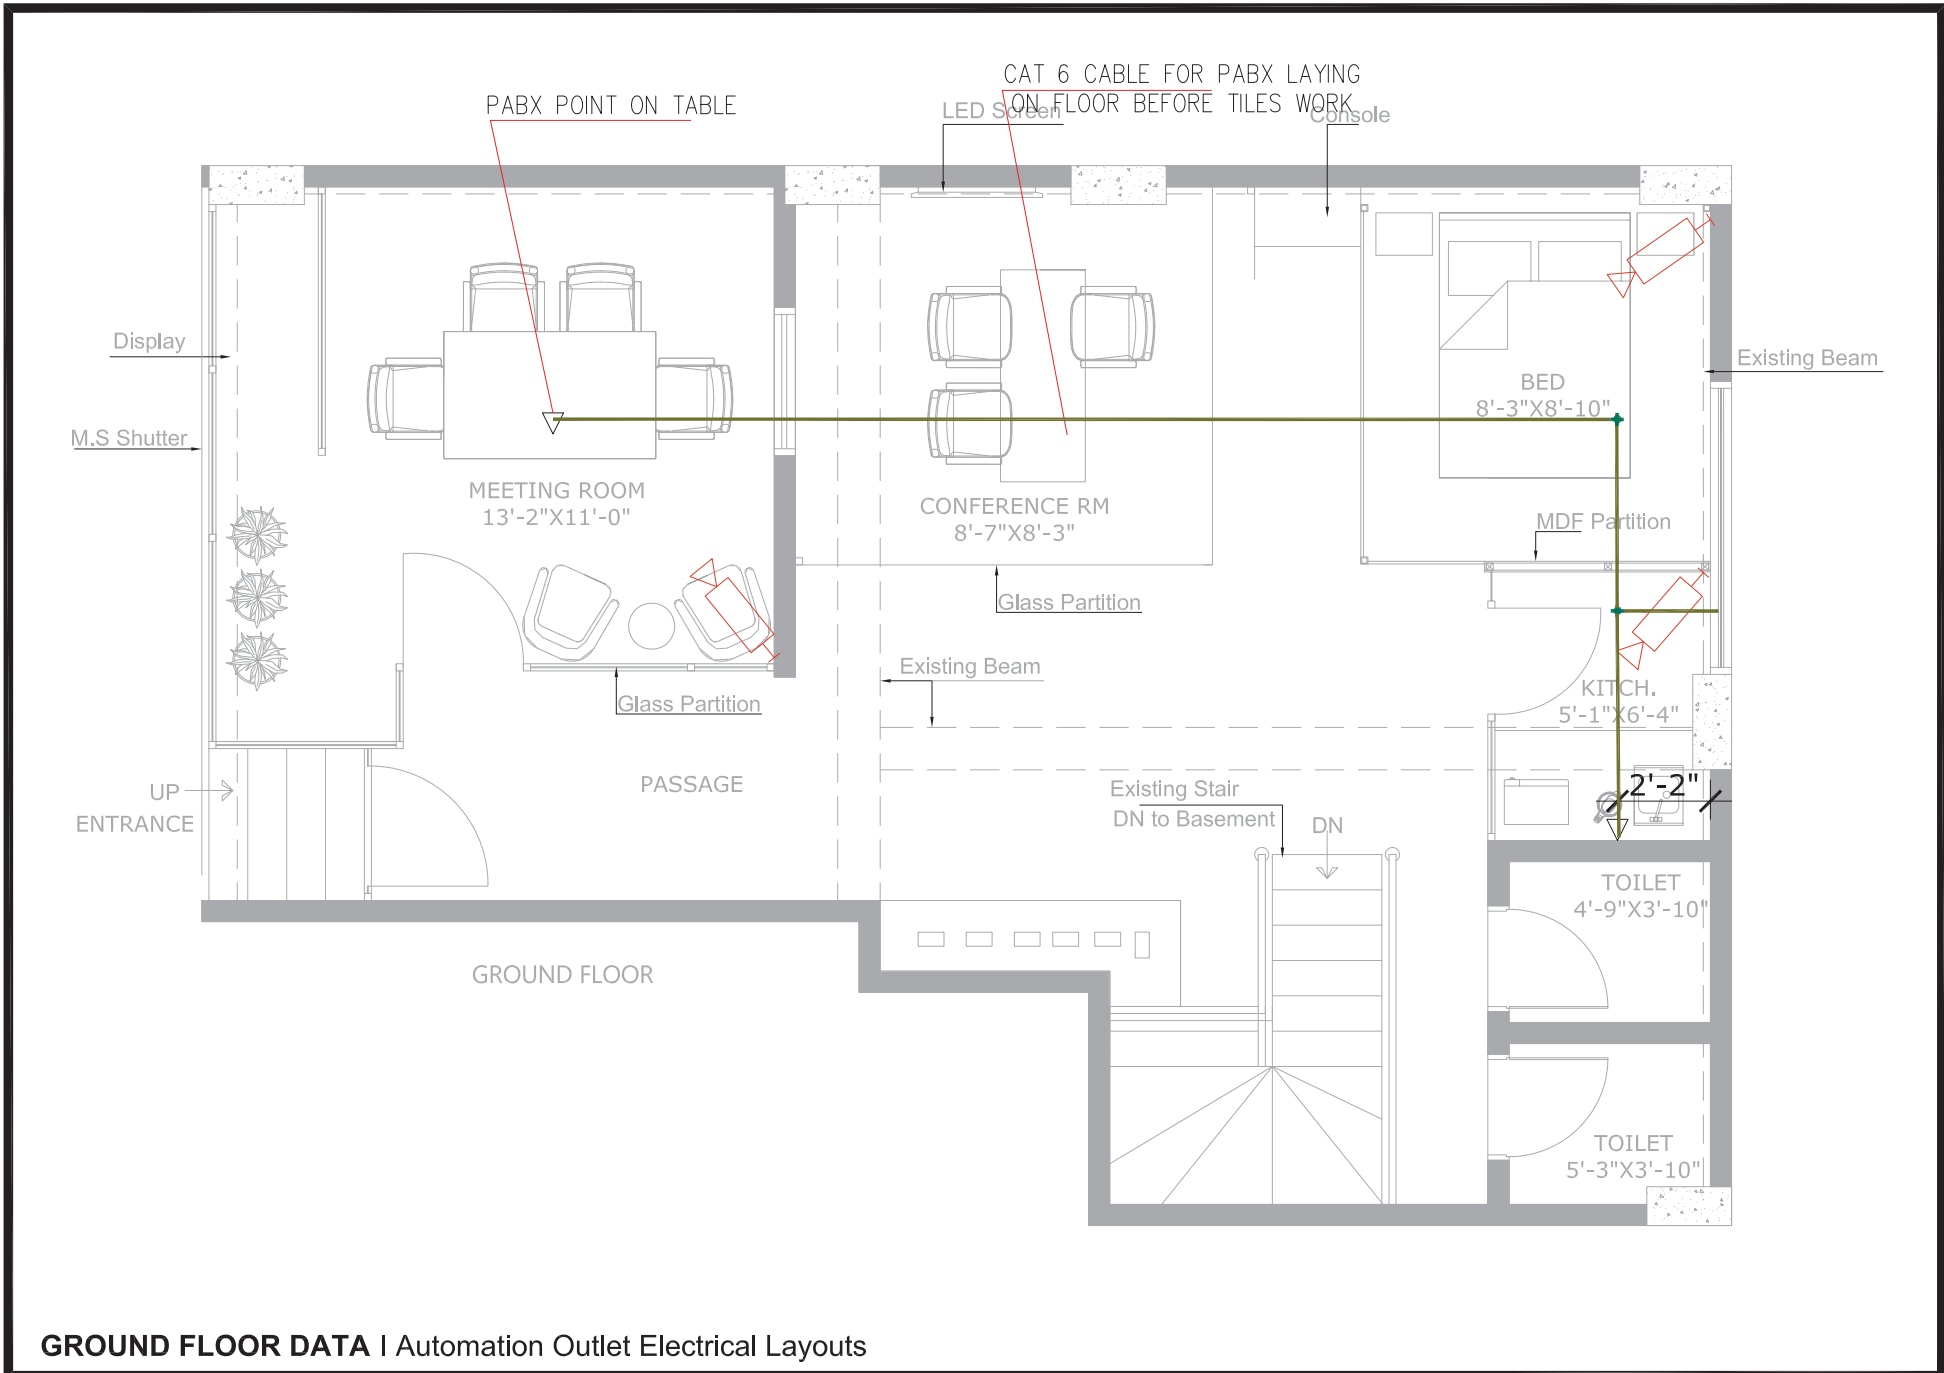


GROUND FLOOR DATA | Automation Outlet Electrical Layouts

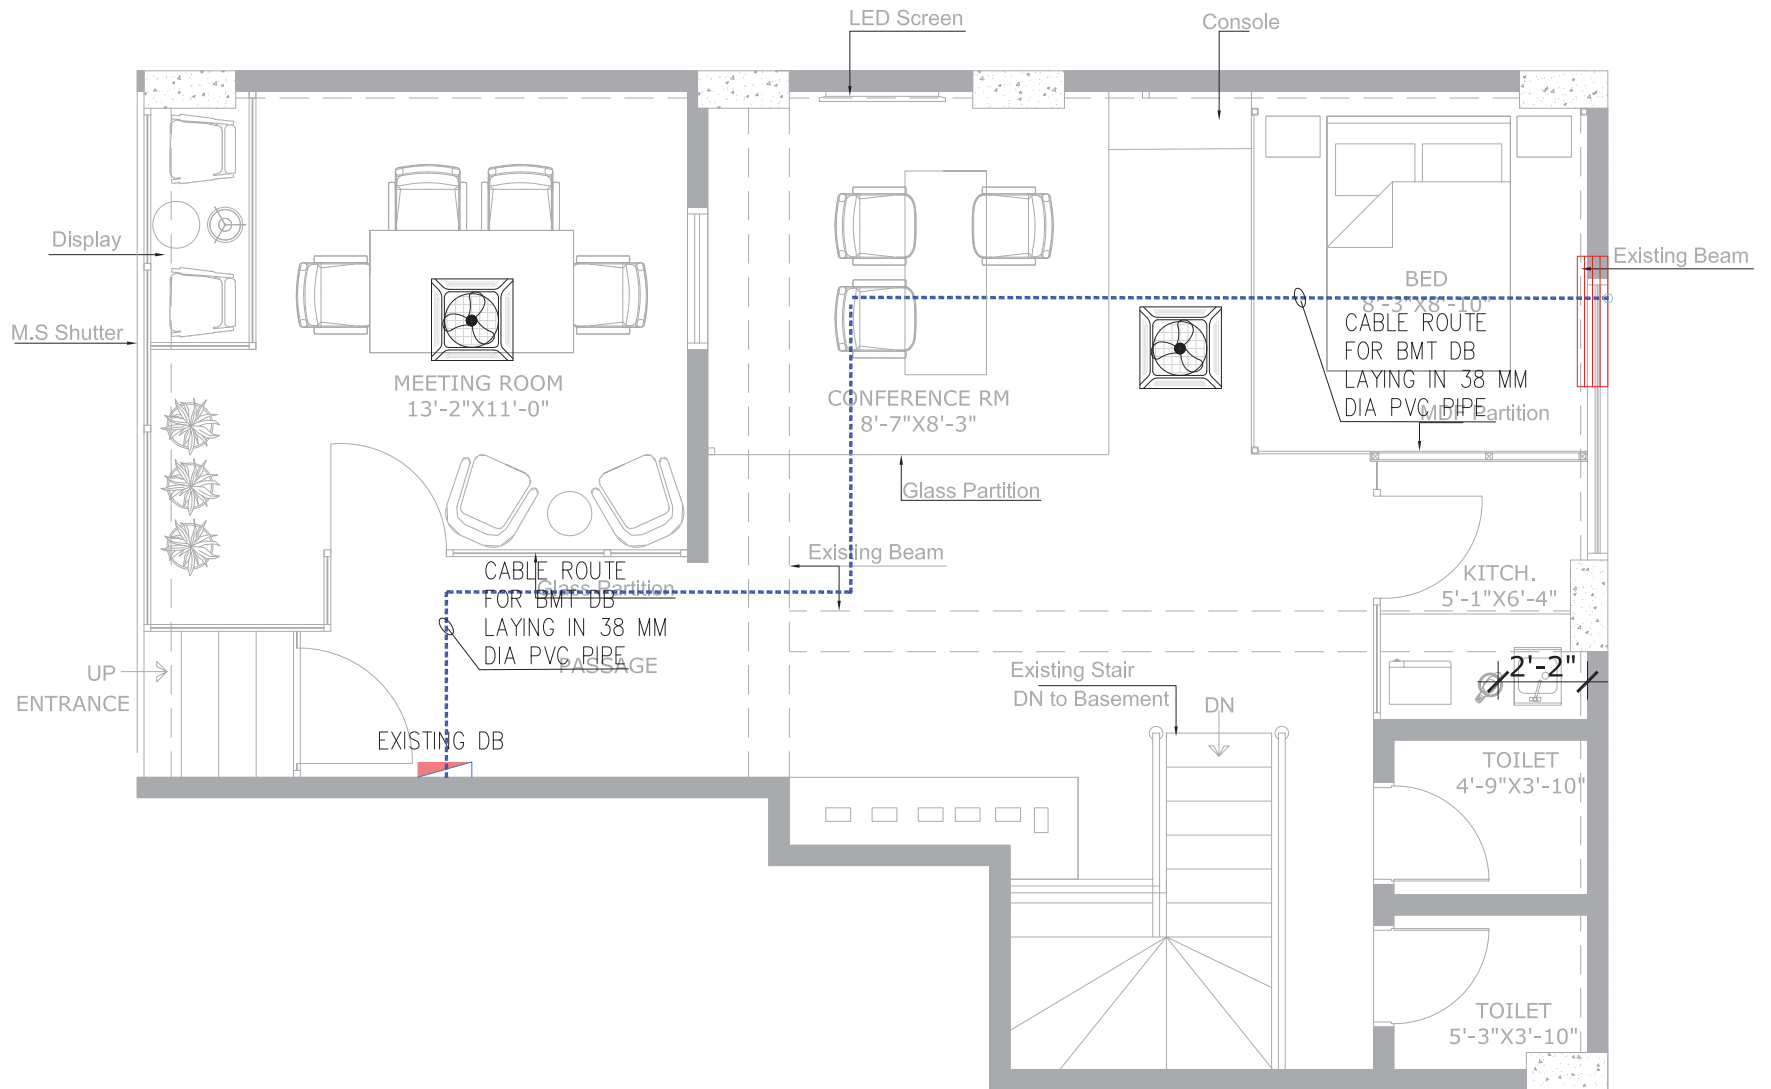


GROUND FLOOR CABLE ROUTE | Automation Outlet Electrical Layouts

ALL CIRCUIT WIRING IS LAYING ON SLAB FROM DB TO SWITCH AND SWITCH TO LIGHT AS CHISELING NOT ALLOWED ON RETAINING WALL


20MM DIA PIPE IS LAYING ON SLAB TO BMT DB AS CHISELING NOT ALLOWED ON RETAINING WALL

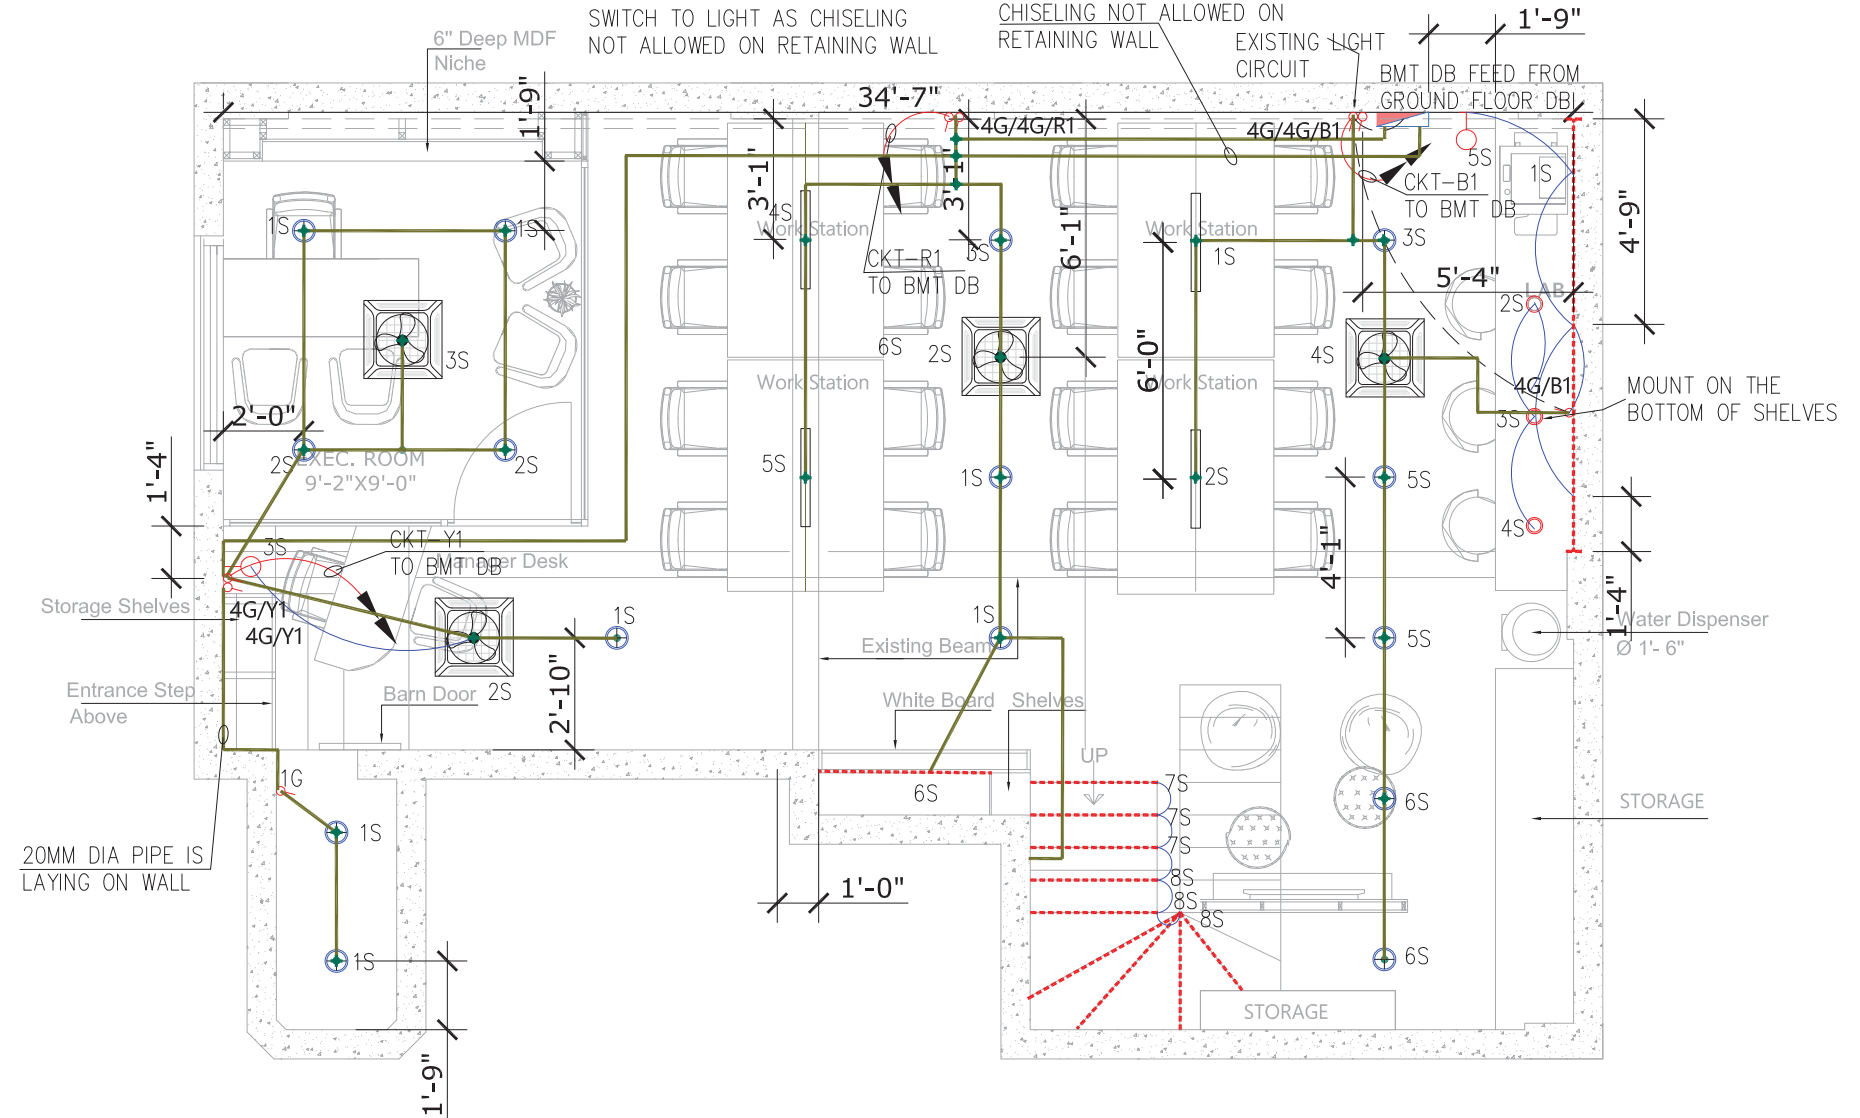

BASEMENT LIGHTING | Automation Outlet Electrical Layouts

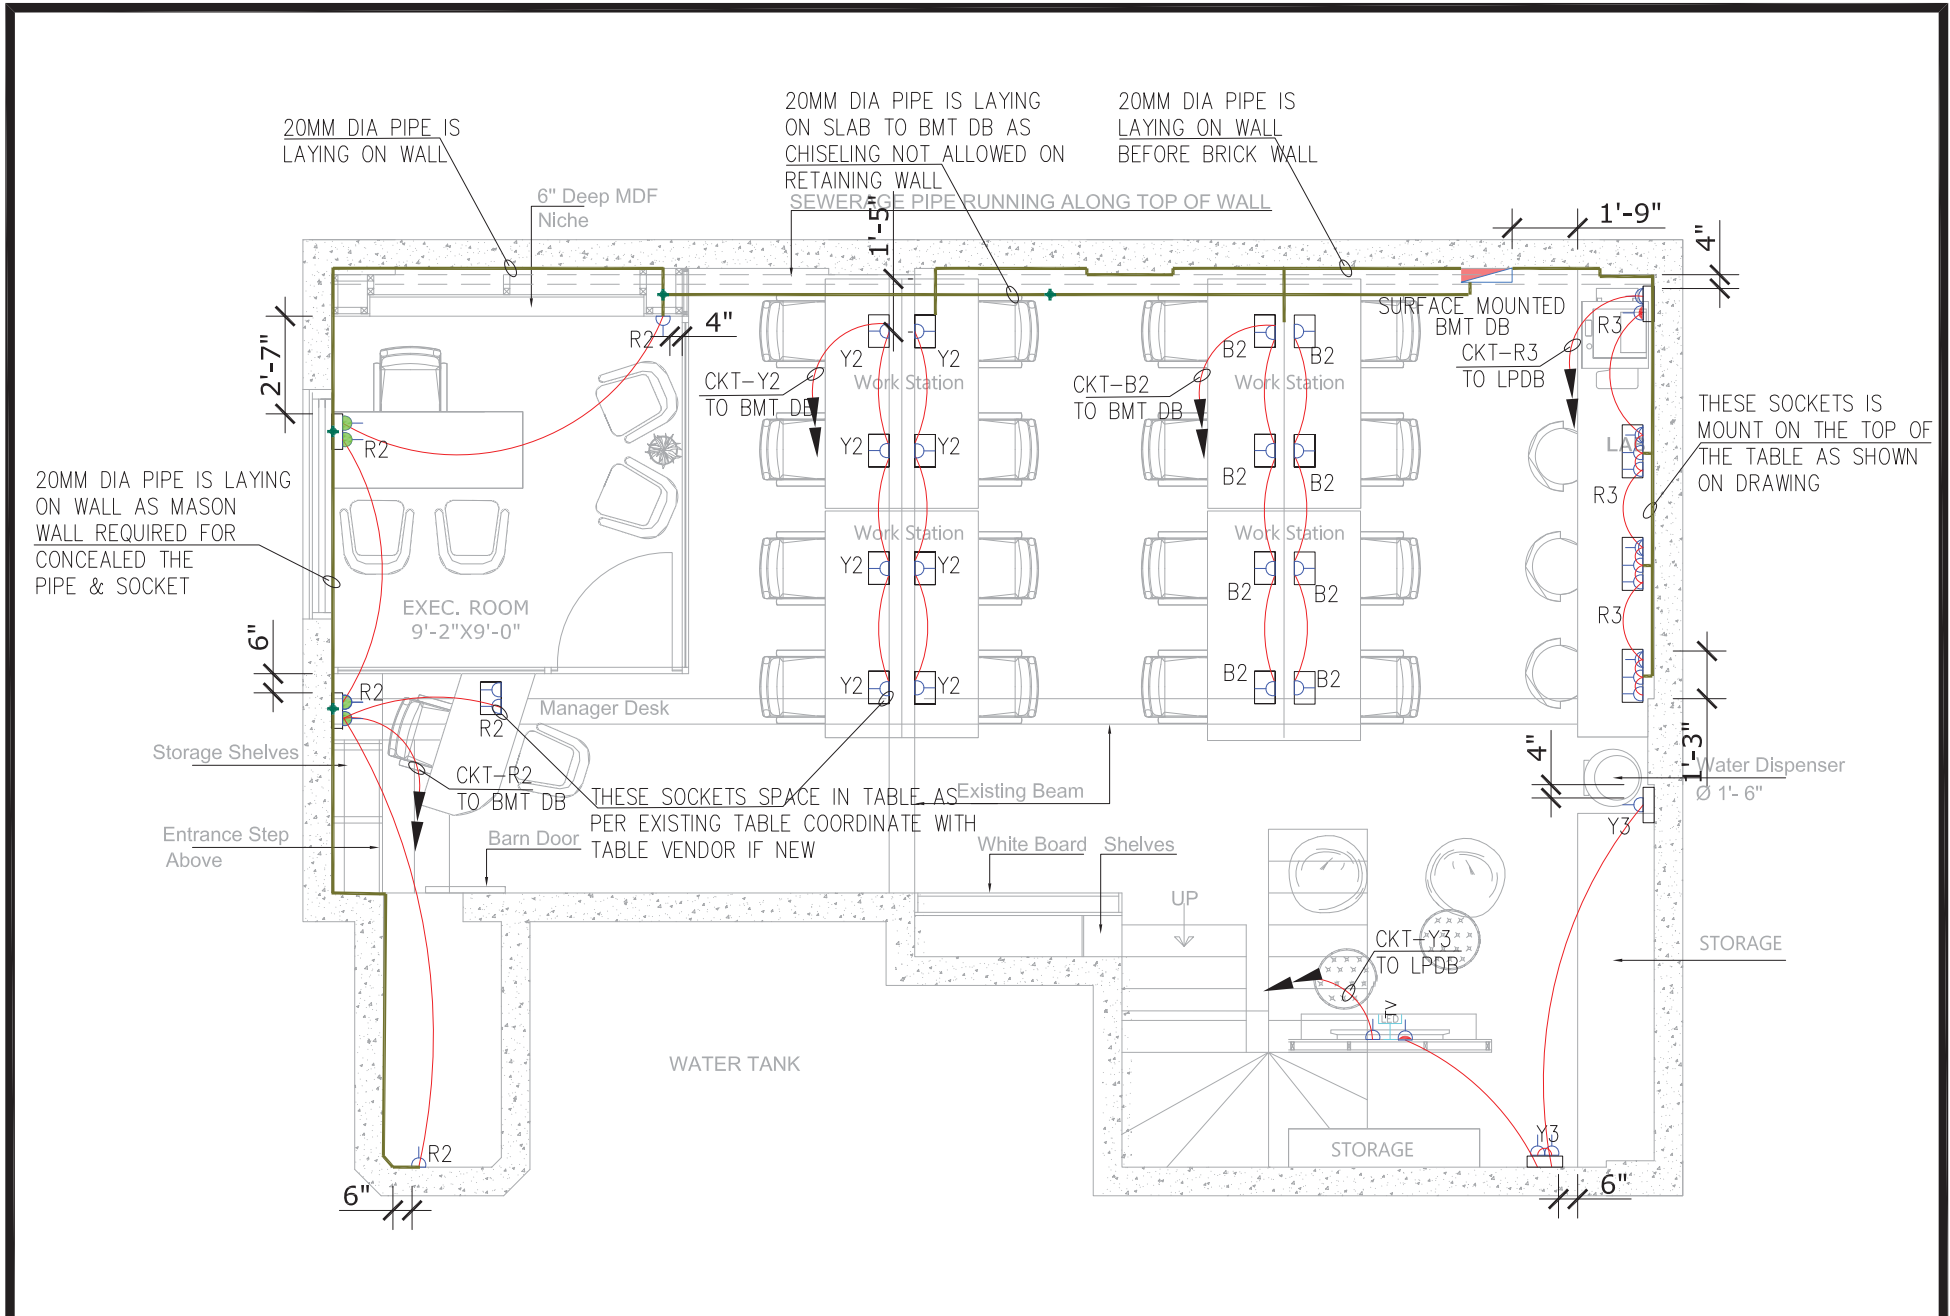

BASEMENT POWER | Automation Outlet Electrical Layouts

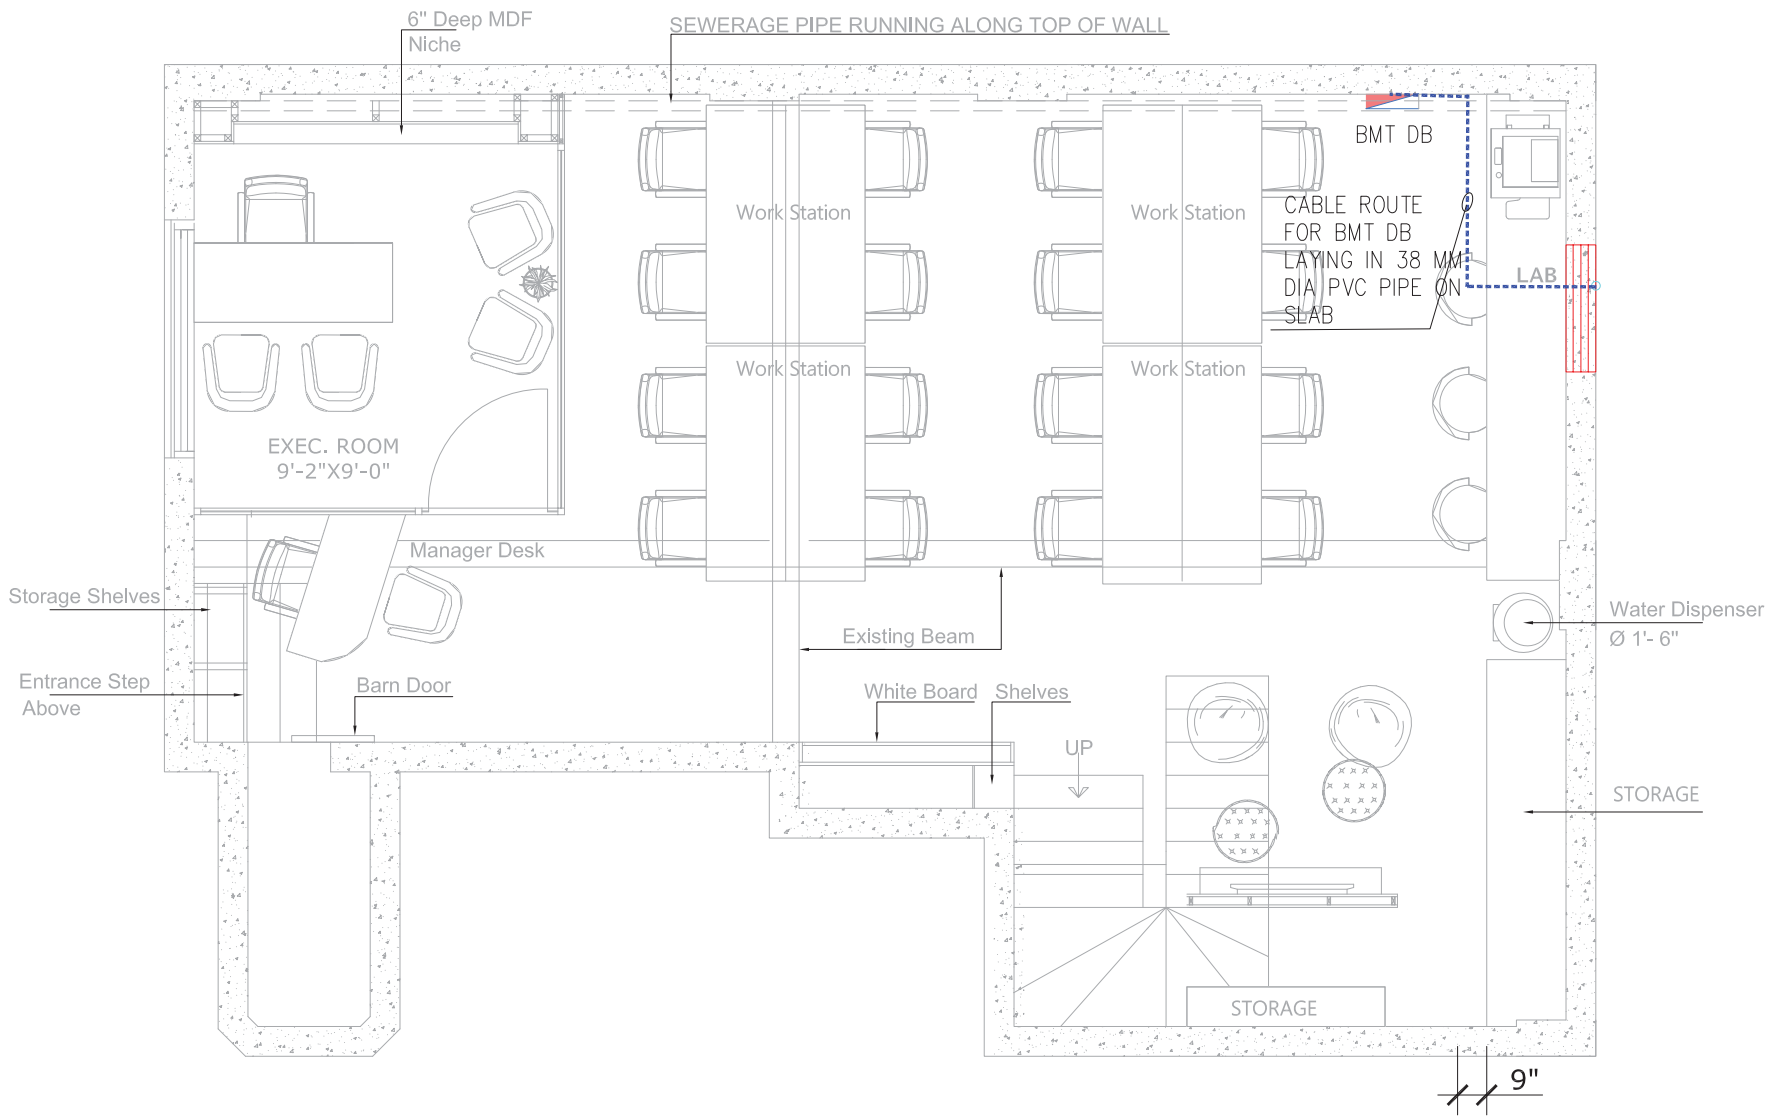

BASEMENT CABLE ROUTE | Automation Outlet Electrical Layouts